



ART.3032 12

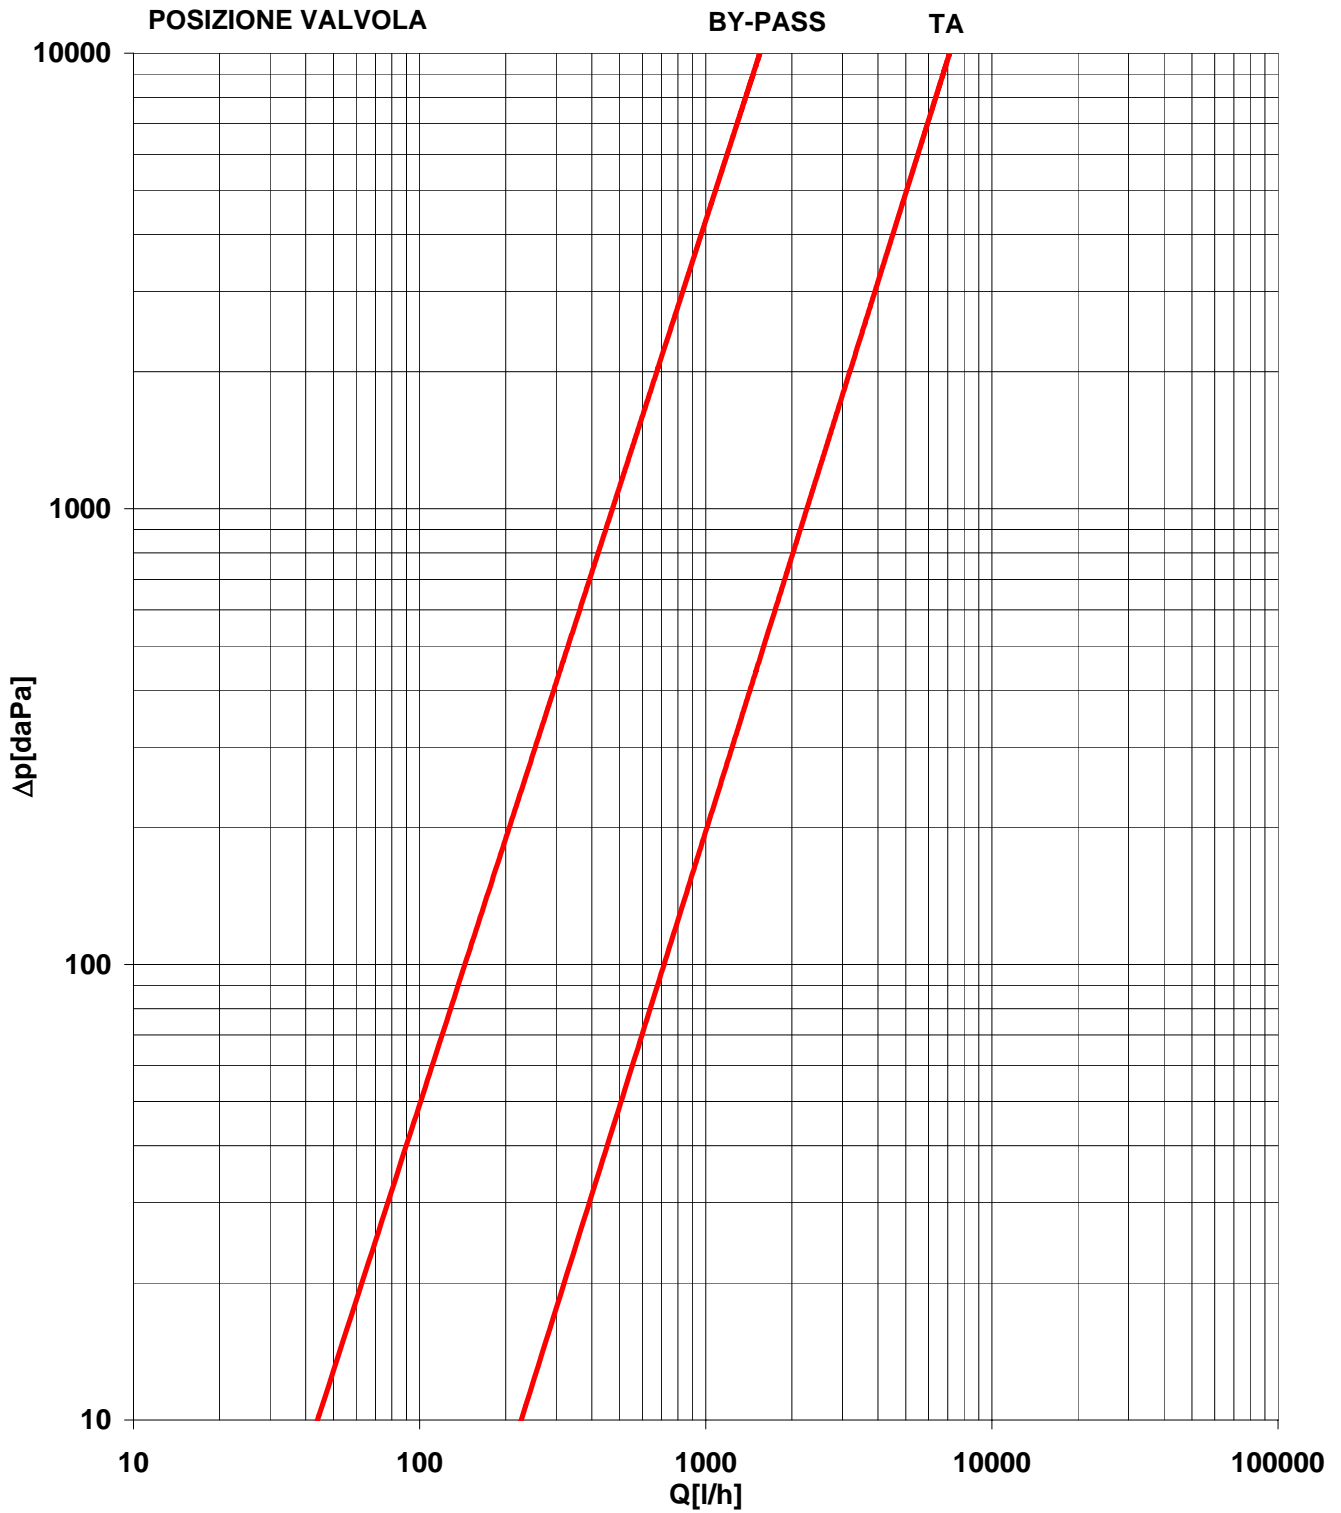


	BY-PASS	TA
Kv [m ³ /h]	1,54	7,11

ART.3032 34

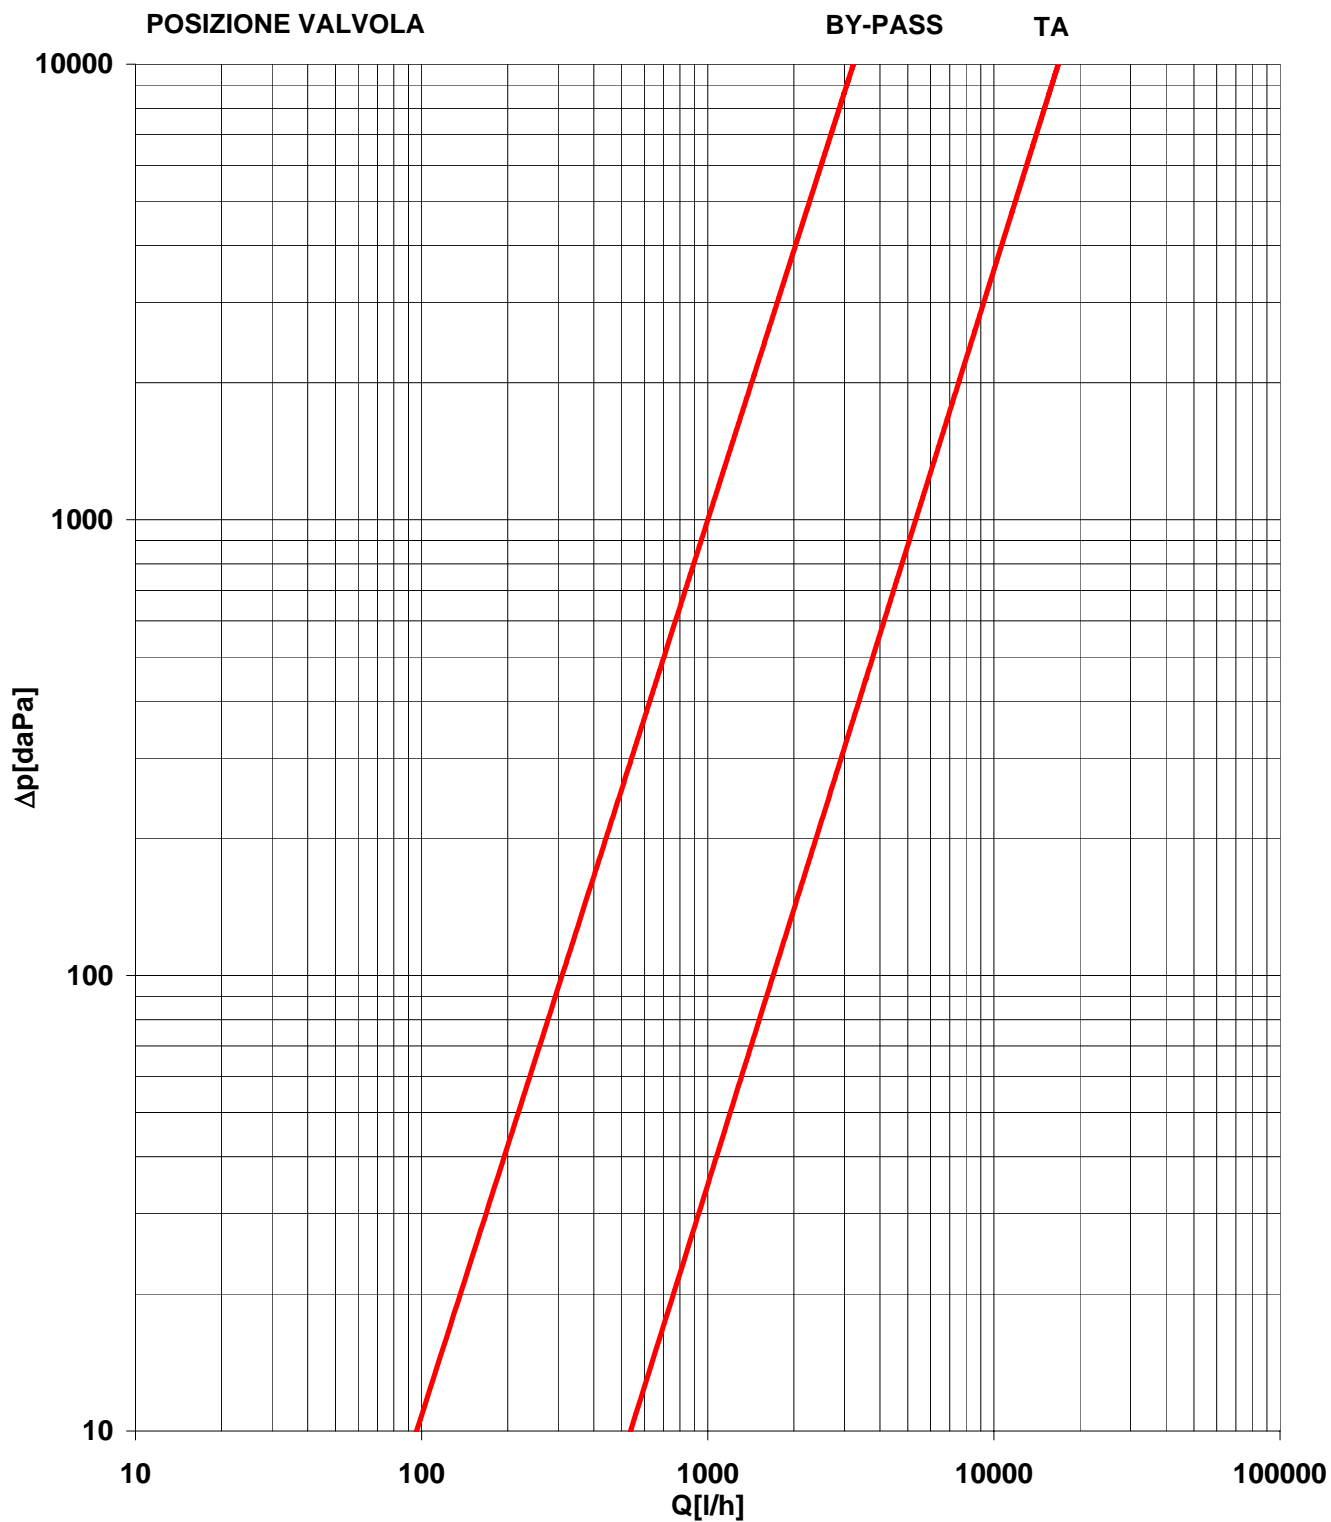


	BY-PASS	TA
Kv [m ³ /h]	3,23	16,8

ART.3032 1

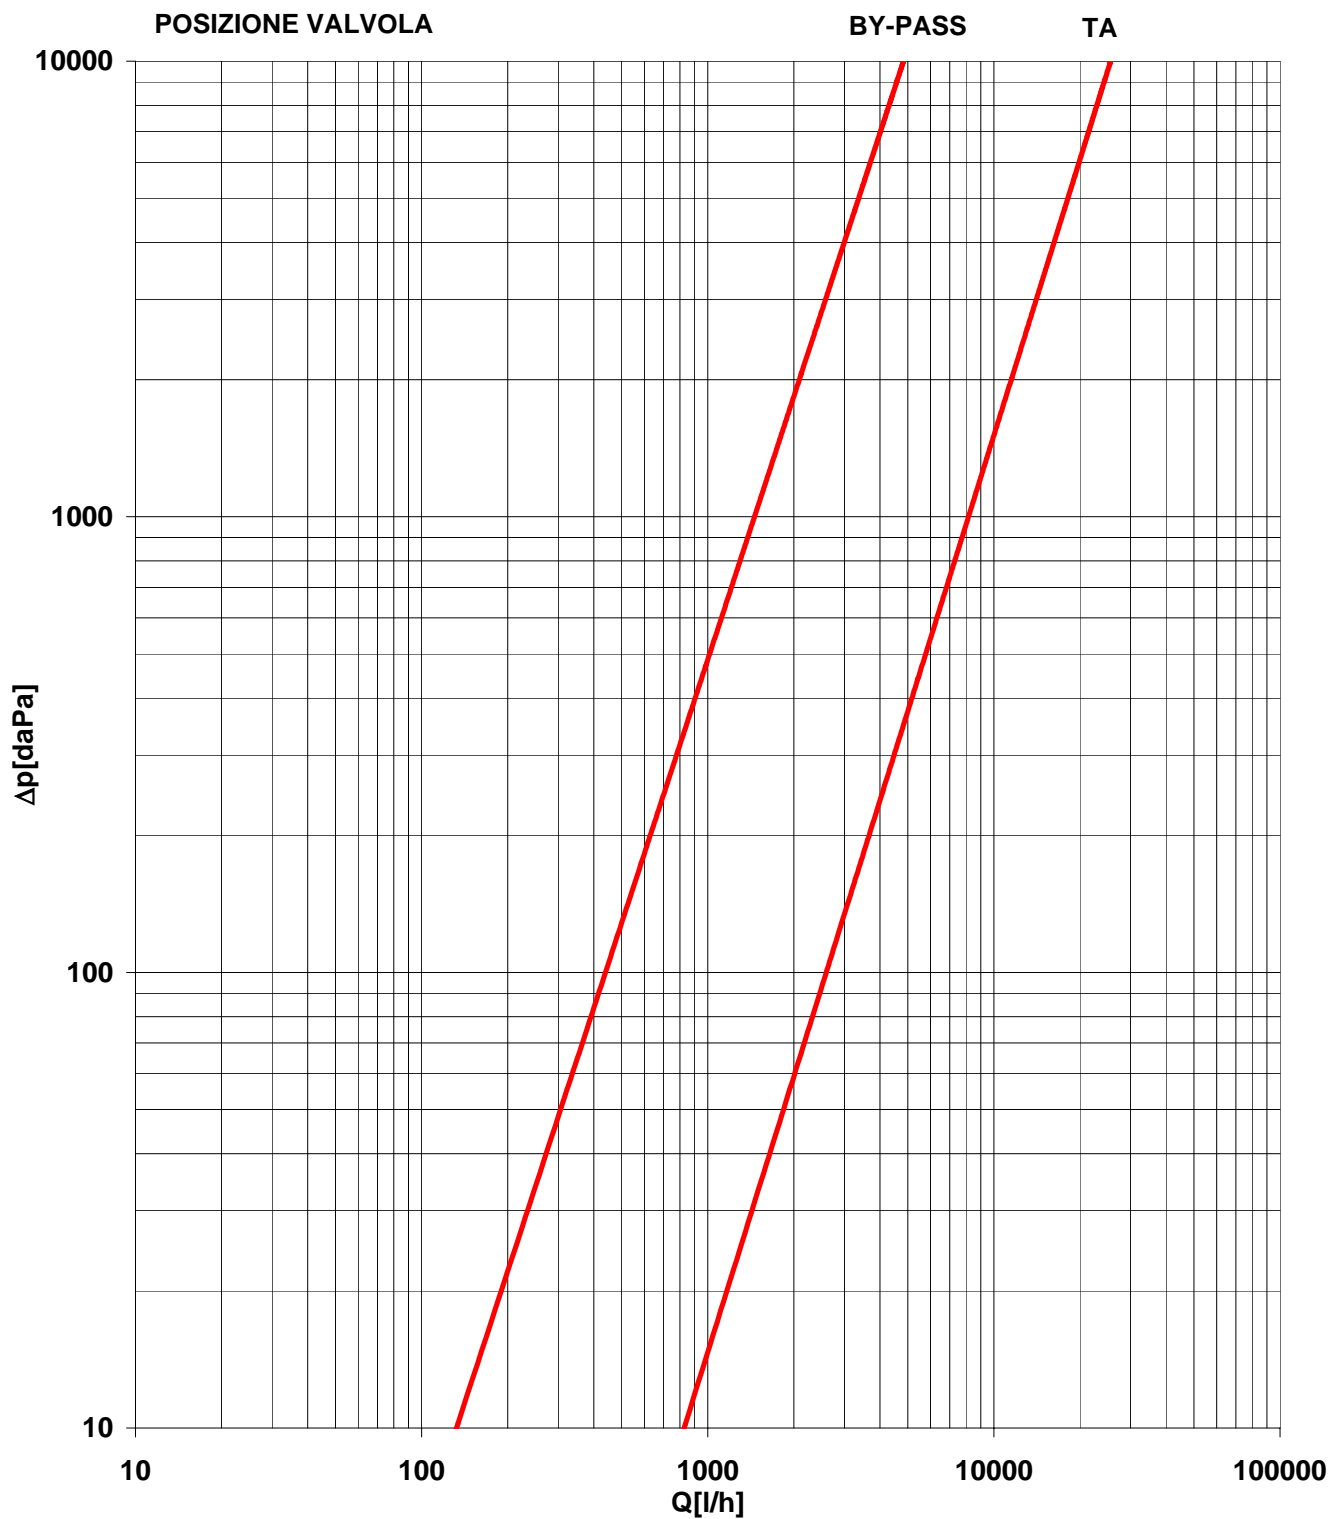

	BY-PASS	TA
Kv [m ³ /h]	4,83	25,6

ART.3032 114

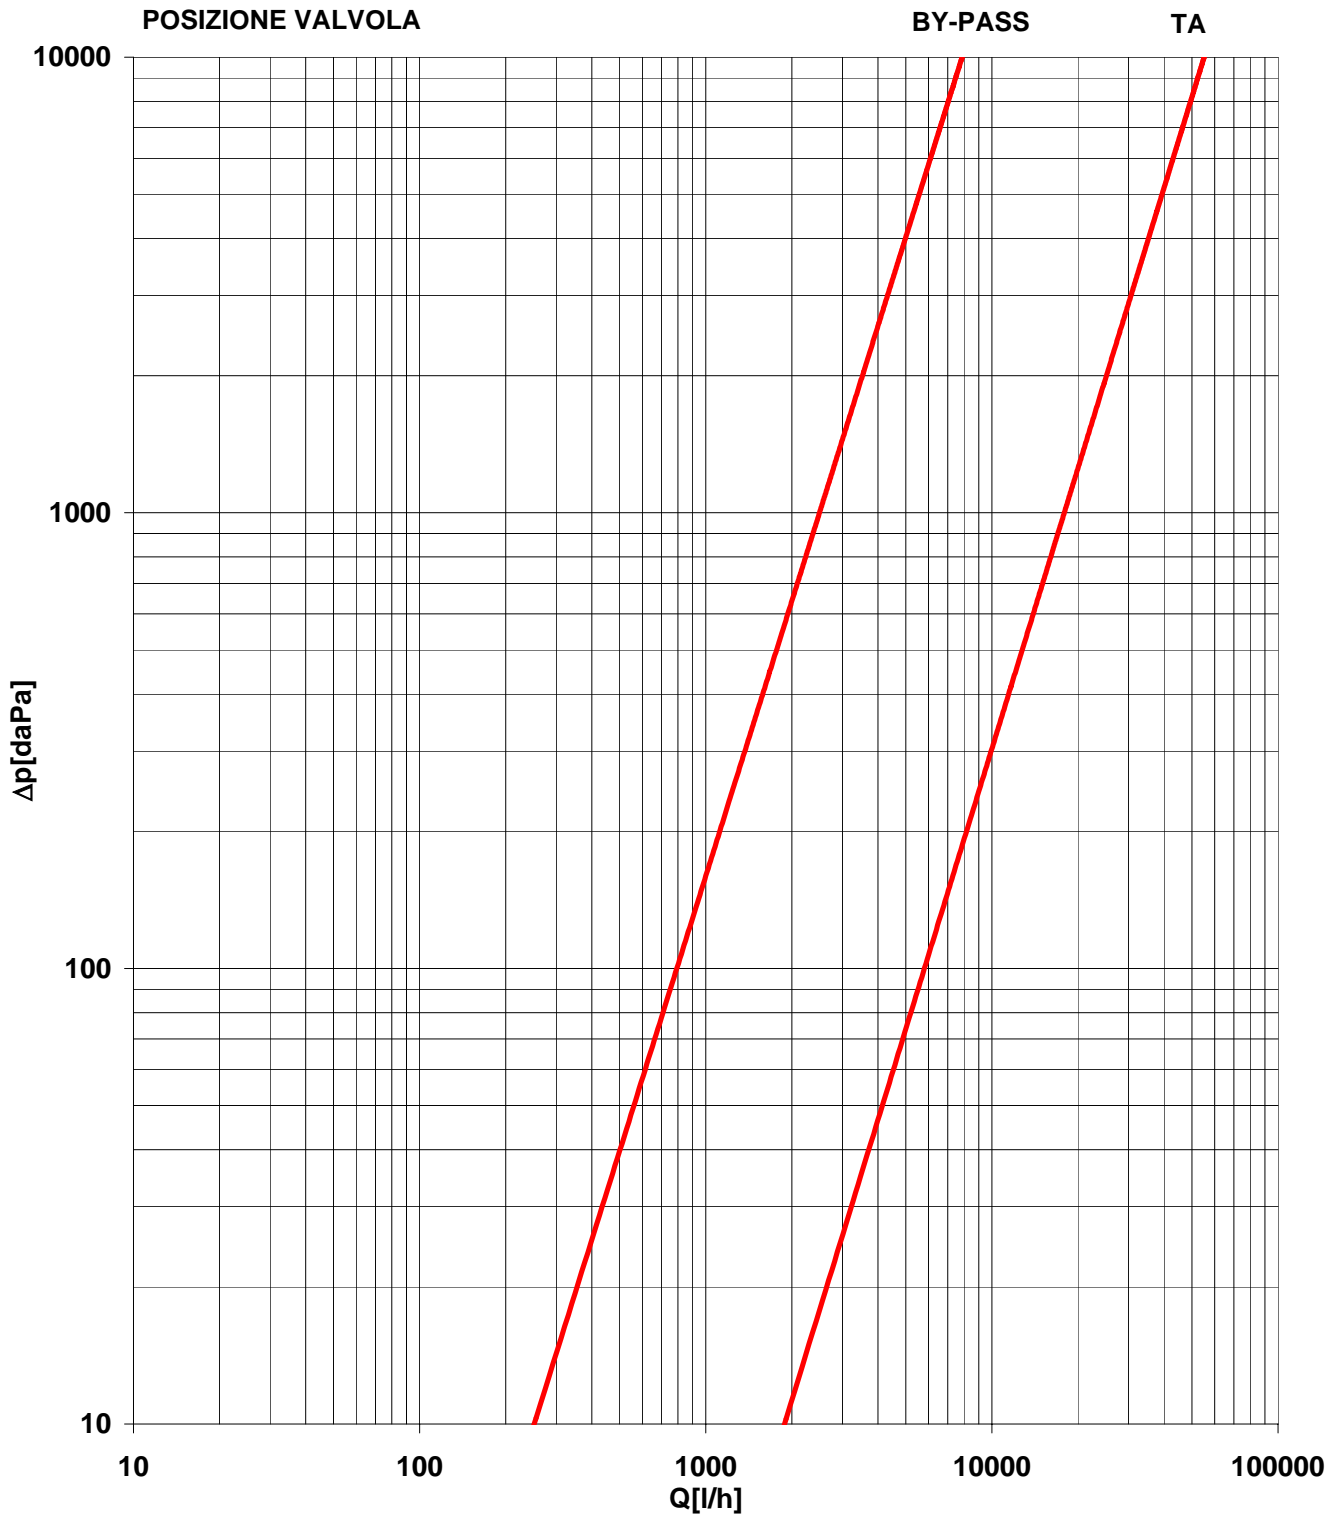

	BY-PASS	TA
Kv [m ³ /h]	7,87	55,17